

Clearance Considerations for Slightly-Irradiated Components of Fusion Power Plants

L. El-Guebaly¹, R. Pampin², M. Zucchetti³

¹ *University of Wisconsin-Madison, Madison, WI, U.S. (elguebaly@engr.wisc.edu)*

² *EURATOM/UKAEA Fusion Association, Culham Science Centre, Abingdon, U.K. (raul.pampin@ukaea.org.uk)*

³ *EURATOM/ENEA Fusion Association Politecnico di Torino, Torino, Italy (zucchetti@polito.it)*

Abstract

The development of commercial fusion plants includes the demonstration that the waste burden for future generations would be avoided. In order to minimize the radioactive material requiring long-term storage, maximum emphasis should be placed on recycling and clearance, avoiding geologic disposal. Clearance is the most desirable option for components like the vessel, shield, magnets and bioshield, which make up a great part of the mass and are only mildly irradiated. Recently, the International Atomic Energy Agency, the U.S. Nuclear Regulatory Commission and other institutions have revised clearance guidelines for nuclear applications. In this paper, the implications of these new standards, particularly for slightly irradiated fusion materials, are considered. The amount of clearable materials is lower and/or the cooling period is longer than previously estimated. It becomes more evident now that improvements to the clearance data are needed to include many missing fusion-specific nuclides, and that the control and measurement of impurity levels, even for materials subjected to low neutron exposure, is important. Segregation of components into more basic parts also plays a key role in minimizing the amount of waste. Finally, the issue of public acceptability of cleared materials is discussed since the unrestricted release of radioactive materials to the market is still controversial, despite the extremely low level of activity ($\leq 10 \mu\text{Sv/y}$) – way below the natural background.

1. Introduction

To fully exploit the favorable inherent safety and environmental characteristics of fusion power, careful attention should be paid to the disposition of active materials during operation and after decommission. In order to minimize (or eliminate) the volume of activated materials that requires long-term storage ($> 100 \text{ y}$), full use should be made of both recycling within the nuclear industry and “clearance” or release to the commercial market as non-radioactive material for general recycling. The latter has recently been considered in several conceptual fusion power plant studies over the last decade [1-5]. This paper examines the feasibility of applying the clearance approach to the slightly activated components of the newly developed U.S. and EU fusion power plants using the most recent clearance guidelines.

2. Clearance Regulations

Clearance, as defined by the International Basic Safety Standards (BSS) for Protection against Ionizing Radiation and for the Safety of Radiation Sources [6], means the removal of radioactive materials or radioactive objects within authorized practices from any further regulatory control by the regulatory agency. Removal from control in this context refers to control applied for radiation protection purposes.

For the clearance of materials, guidelines have been issued by competent authorities, and over the past five years, the U.S. Nuclear Regulatory Commission (NRC), European

Commission, and International Atomic Energy Agency (IAEA) have issued revised clearance levels, taking into account the previous guidelines.

Concentration limits for clearance are issued in the IAEA guidelines for each relevant nuclide for fission and fusion [7]. For materials with more than one radioactive nuclide, given the specific activity A_i (in Bq/g) and the clearance level L_i of each nuclide contained in the material, a clearance index (CI) can be computed as the weighted sum of all nuclide specific activities divided by the corresponding clearance limits:

$$CI = \sum_i (A_i / L_i).$$

The CI of a mixture of nuclides should be at or below one for the material to qualify for clearance. Typically, it would be an aim to achieve this during the 100 year storage period following decommissioning, and preferably within a few years. Based on a detailed technical study, the NUREG-1640 document [8] contains estimates of the total effective dose equivalent (from which the clearance index can be derived) for 115 radionuclides that could be present in activated steel, copper, aluminium, and concrete from decommissioning of nuclear facilities. The NRC has not yet issued an official policy on the unconditional release of specific materials. Herein, the proposed annual doses reported in the NUREG-1640 document will be referred to as the proposed U.S. limits.

3. Implications of New Clearance Levels for Fusion Designs

The clearance strategy would appear to have great potential for fusion, since its application could greatly reduce the amount of materials to be disposed of or recycled. Recent studies have in fact shown the following:

- a) ARIES power plants: about 80% of the activated material volume (mainly the magnet structure, magnet Cu stabilizer, cryostat, and bioshield) could be cleared while ~20% (the blanket, shield, manifolds, vacuum vessel, and Nb₃Sn superconductor) could either be recycled or disposed of as low-level waste [9,10] after a specific storage period.
- b) PPCS plant models: between 17 and 24% of the activated material mass could be cleared, and between 76 and 83% recycled [11] after 100 years interim decay.

3.1 ARIES – Advanced Research, Innovation, and Evaluation Study

The multi-institutional ARIES team launched a study in 2003 to provide perspective on the benefits of optimizing the physics and engineering characteristics of the so-called compact stellarator (CS) power plant [12]. The reference ARIES-CS design has a power level of 1000 MW_e. The ferritic steel-based, dual-cooled LiPb/He blanket along with the shield helps protect the vacuum vessel (VV) and all three components protect the superconducting magnets for life. The neutron wall loading (NWL) peaks near the outboard midplane at 5.3 MW/m², calling for blanket replacement every 3 FPY, while the average NWL is 2.6 MW/m². The details of the radial builds, component compositions, and list of alloying elements and impurities are posted at: <http://fti.neep.wisc.edu/aries-cs/builds/build.html>.

The clearance index of each component depends strongly on the neutron flux level, neutron spectrum, composition, and service lifetime. Because of the compactness of ARIES-CS, the CIs

of all internal components (blanket, shield, manifolds, and vacuum vessel) exceed the clearance limit by a wide margin even after an extended period of 100-500 y [9]. No changes have been made to deliberately clear these components as the addition of new shielding components outweighs the benefits and defeats the waste minimization goal. This means that the in-vessel components should be recycled or disposed of in repositories as low-level waste (LLW) according to the U.S. waste classification guidelines [9]. Examining the magnet constituents indicates that the JK2LB steel structure and Cu stabilizer are clearable within 100 y according to the U.S. guidelines. Of interest is the 2 m thick external concrete building (bioshield) that surrounds the torus. It represents the largest single component of the decommissioned waste. Fortunately, the bioshield along with the 5 cm thick cryostat and some magnet constituents qualify for clearance, representing ~80% of the total active material volume.

Since the ultimate goal is to separate the constituents of the component for recycling and reuse by industry, the ARIES approach for handling the cleared components ($CI < 1$) is to re-evaluate the CIs for the constituents [2]. The entire component could have a $CI < 1$, but the individual constituents may not and vice versa, requiring further segregation of the active materials based on constituents rather than components. Applying this approach to the ARIES-CS magnet indicates that all constituents (JK2LB structure, Cu stabilizer, and insulator) can be cleared within 20-300 y, except the Nb_3Sn superconductor [10].

We propose another approach to deal with sizable components, such as the 2 m thick bioshield. It should be segmented and reexamined. As such, the ARIES-CS bioshield was divided into four segments (0.5 m each) and the CIs reevaluated for the constituents (85% concrete and 15% mild steel, by volume). The results indicate that the innermost segment has the highest CI while the outer three segments meet the clearance limit within a few days after decommissioning. As Figure 1 indicates, the mild steel is a major contributor to the CI although its volume fraction is only 15%. The recommended storage periods are given in Table 1 along with the dominant radionuclides in descending order. Note that the inconsistencies in the ^{14}C and ^{63}Ni clearance standards, with the U.S. allowing 100-500 fold higher limits relative to IAEA [4,10], result in a wide variation in the required storage period for the coil structure and mild steel.

TABLE 1. STORAGE PERIODS FOR ARIES-CS INTERCOIL STRUCTURE, CRYOSTAT, AND CONSTITUENTS OF INNERMOST SEGMENT OF BIOSHIELD

Constituents	U.S.	IAEA
Cu Stabilizer	20 y ^{60}Co	~100 y ^{63}Ni
Inter-coil Structure (JK2LB)	10 y ^{54}Mn	~500 y $^{14}C, ^{63}Ni$
Cryostat (304 SS)	64 y ^{60}Co	70 y $^{63}Ni, ^{60}Co$
Bioshield:		
Mild steel	3.5 y $^{54}Mn, ^{55}Fe, ^{60}Co$	7 y $^{54}Mn, ^{55}Fe$
Concrete	0.6 y $^{22}Na, ^{54}Mn, ^{59}Fe, ^{41}Ca$	0.6 y $^{54}Mn, ^{22}Na, ^{45}Ca, ^{55}Fe$

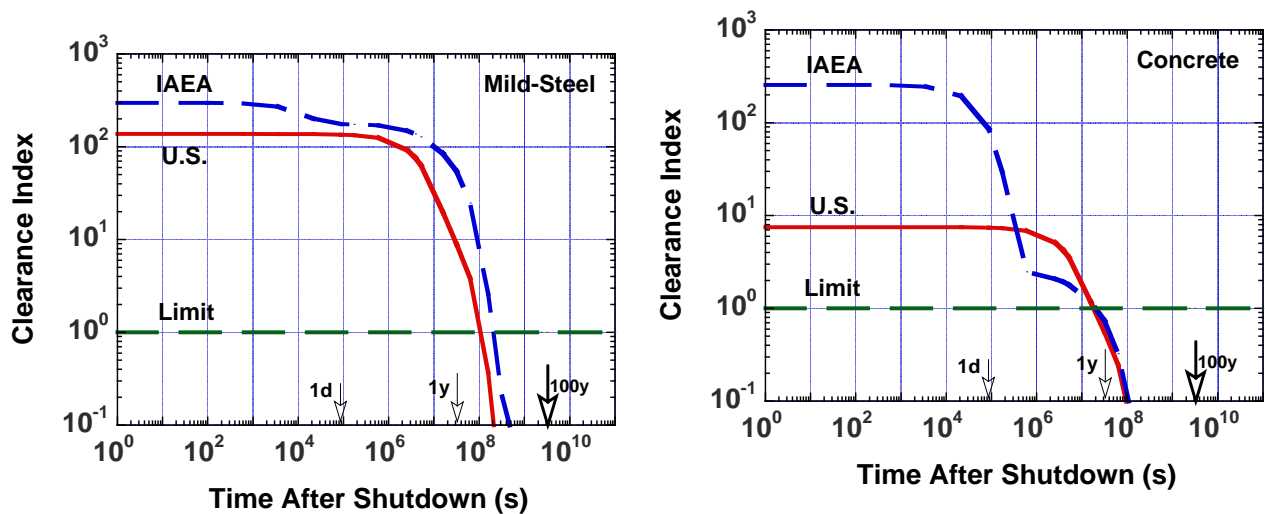


Fig. 1. Comparison of U.S. and IAEA clearance indices for steel and concrete of innermost segment of bioshield.

3.2 PPCS – Power Plant Conceptual Study

Revision is being made of the radioactive waste analysis of the PPCS plants based on ITER test blanket modules [11], accounting for the latest design features and nuclear regulations; a more comprehensive approach to the overall waste management strategy is being developed. For the 1.5 GWe plant model PPCS-AB [13], based on a helium-cooled LiPb concept, previous analyses using 1996 IAEA levels resulted in all of the outboard and parts of the inboard legs of the toroidal field coils (TFC), and most of the outboard vacuum vessel (VV), reaching clearance within 100 years (27% of the total waste, which amounts to ~124000 tonnes) [14]. Under the 2004 IAEA guidelines, calculations performed so far have resulted in less parts of the inboard TFC, and none of the outboard VV, achieving clearance. The fraction of clearable material in model AB after 100 years is now ~13%. Figure 2 shows time-after-shutdown histories of the clearance index for the outer, lifetime components of this plant model: low temperature shield (LTS), VV and TFC, at the inboard and outboard midplane.

Mechanisms for the reduction of waste mass are being explored. If refurbishment and direct reuse of the LiPb breeder during operation is foreseen, for instance, the total amount of waste falls down to ~97000 tonnes, the total fraction of clearable material then being ~17%. Sometimes an entire component does not achieve clearance but individual constituents and/or radial/poloidal parts of it do so, such as the case of the inboard leg of the TFC in model AB [10]. The lowermost and uppermost poloidal sectors achieve clearance, whereas the rest do not. Also the rear steel case, radial plates and epoxy-glass insulator achieve clearance all along the inboard side, whereas the front case, incoloy and superconductor cable do not; this is illustrated in Figure 3. A similar effect is found in the outboard side of the VV, where the average CI does not permit clearance but that of the outer wall does so. Segregation of components into more basic constituents/parts thus plays a key role in minimizing the amount of waste requiring disposal or recycling; results show that, if convenient separation is made, the amount of cleared material from PPCS-AB could be increased to ~24% of the total, still under 2004 IAEA guidelines.

Some specific effects of the more stringent IAEA levels have already been pointed out [4,5]. In particular, a 30-fold decrease of the ^{63}Ni level appears to become a particular concern in the case of conventional 316 grade steel used for the VV and TFC walls, casing and radial plates; its

effect is crucial in the case of PPCS-AB outboard VV. Similar decreases in ^{125}Sb and ^{94}Nb levels also affect, although less dramatically, the superconductor strands, reducing the amount of clearable material from the TFC. These elements are main constituents of the original materials; in the case of the 316 steel for VV and TFC applications, the use of ferritic, low-activation variants has been recommended. Traces of impurities at the level of detection limits have certain influence in some cases, providing the difference between clearance and disposal; in 316 steel, even prior to irradiation, naturally occurring radioisotopes of Rb and Re impurities provide a background CI of 0.22, according to the 2004 IAEA levels (see Figure 3). The majority of nuclides contributing to the CI up to 100 years, however, arise from isotopes in the main elements in the composition of the materials of interest such as those previously mentioned. Moreover, uncertainty in the nuclear data introduces a stochastic component in the overall analysis.

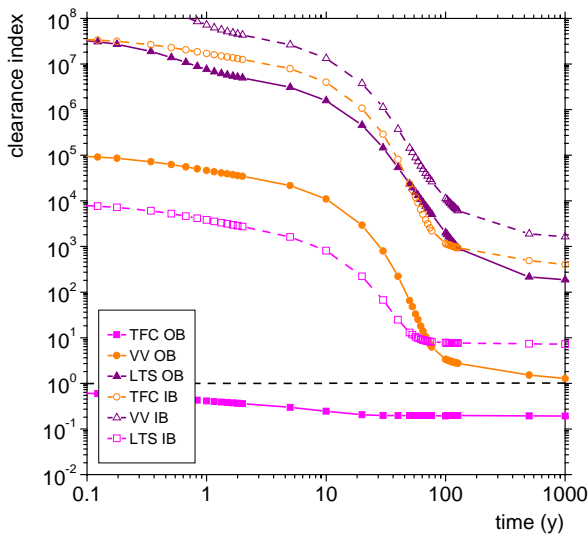


Fig. 2. CI time histories of lifetime components in PPCS-AB, at inboard and outboard midplane.

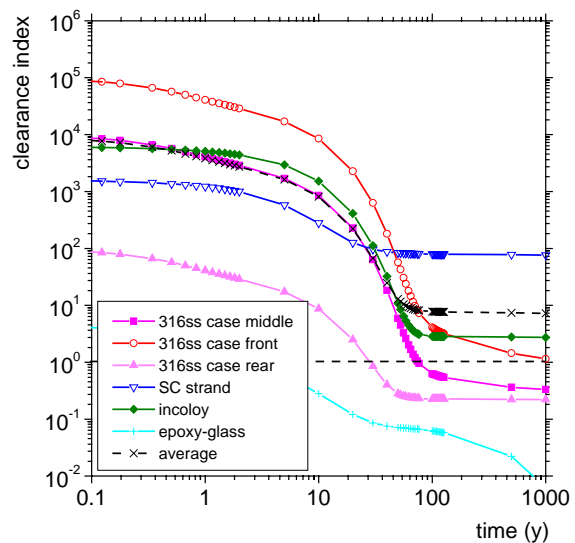


Fig. 3. CI time histories of the different TFC materials at the inboard midplane of PPCS-AB.

4. Public Acceptability of Clearance

Further aspects must be considered for clearance, besides the question of its radiological feasibility, like for instance the issue of public acceptability of cleared materials. At present, there is no commercial market for the free (unconditional or unrestricted) release of slightly contaminated materials except in Germany and Spain. Such a market will become increasingly important in this new millennium as the eventual decommissioning of fission and fusion power plants generates large amounts of slightly radioactive materials. Although the nuclear industry favors some form of clearance standards, many consumer and environmental groups do not. For instance, the U.S. metals and concrete industries do not support clearance that unconditionally allows slightly radioactive solids to enter the commercial market, no matter how restrictive the clearance standards might be. Both industries expressed serious concerns that the presence of radioactive materials in their products could negatively affect their sales due to public fear. However, they would support a restricted use scenario in which radwaste reuse would be limited

to selected purposes (e.g., nuclear facilities or radioactive waste containers) and subject to a high degree of control by the NRC. As clearance is highly desirable for both fission and fusion facilities, the national and international organizations are urged to continue their efforts to convince industrial as well as environmental groups that clearance of slightly radioactive solids can be conducted safely with no risk to the public health.

The length of the interim decay period (needed to drop the CI below one) could be a key issue for the public acceptability of cleared materials and deserves further considerations. An open question is: should the interim decay period be fixed a priori to 50-100 y, or chosen according to an optimization process where many factors are accounted for?

5. Conclusions

One of the main goals for fusion should be the minimization of radioactive materials that need permanent disposal with a management strategy including the maximum reasonably possible use of materials clearance. This could result in a clear advantage for fusion power, in view of its ultimate safety and public acceptance. A review of power plant studies results in this field (ARIES and PPCS) shows excellent potential results as the majority of these power plant materials seem clearable, in principle.

Revised clearance limits have been recently issued at the international level and in the U.S. and Europe. The implications for fusion materials of these new levels are of interest. Some examples of reevaluation of the clearance indices for selected power plant concepts show that the amount of clearable material could be lower than previously estimated. However, the following general points can be noted:

- Differences between the various standards are relevant, and – for fusion-related materials – further studies are recommended to understand the technical reasons for the major disagreements.
- It is understood that a single set of international clearance limits – for all countries and for all radioactive materials – could be hardly obtained. However, an internationally agreed and complete set of fusion-specific clearance limits should be developed, as a result of further research in this field. In the meantime, we recommend incorporating both national and IAEA standards in fusion clearance evaluations.
- It is necessary to dismantle and segment the components for declassifying the individual materials as non-active, with the possibility that some constituents may not achieve clearance.

Acknowledgement

Part of this work was funded jointly by the UK Engineering and Physical Sciences Research Council, and EURATOM; the views and opinions expressed herein do not necessarily reflect those of the European Commission.

References

- [1] P. ROCCO, M. ZUCCHETTI, Waste Management for Different Fusion Reactor Designs, *Journ. Nucl. Mater.* **283-287** (2000) 1473.
- [2] L. EL-GUEBALY, D. HENDERSON, A. ABDOU, P. WILSON, "Clearance Issues for Advanced Fusion Power Plants," *Fusion Technology* **39**, No. 2 (2001) 986.
- [3] K. BRODÉN, E. ERIKSSON, M. LINBERG, and G. OLSSON, "Clearance and Disposal of ITER Radioactive Waste Components," *Fus Eng. and Des.* **58-59** (2001) 945.
- [4] L. EL-GUEBALY, P. WILSON, D. PAIGE, "Evolution of Clearance Standards and Implications for Radwaste Management of Fusion Power Plants", *Fusion Science & Technology* **49** (2006) 62.
- [5] M. ZUCCHETTI, et al., "The Feasibility of Recycling and Clearance of Active Materials from a Fusion Power Plant," ICFRM-12, Dec. 4-9, 05, Santa Barbara, CA. Available at: <http://fti.neep.wisc.edu/pdf/fdm1286.pdf>
- [6] International Basic Safety Standards for Protection Against Ionizing Radiation and for the Safety of Radiation Sources, Safety Series No. 115, IAEA, Vienna (1996).
- [7] International Atomic Energy Agency, "Application of the Concepts of Exclusion, Exemption and Clearance," IAEA Safety Standards Series, No. RS-G-1.7 (2004). Available at: http://www-pub.iaea.org/MTCD/publications/PDF/Pub1202_web.pdf
- [8] Nuclear Regulatory Commission, "Radiological Assessments for Clearance of Materials from Nuclear Facilities," Washington, D.C., Main Report NUREG-1640 (2003). Available at: <http://www.nrc.gov/reading-rm/doc-collections/nuregs/staff/sr1640/>
- [9] L. EL-GUEBALY, "Evaluation of Disposal, Recycling, and Clearance Scenarios for Managing ARIES Radwaste after Plant Decommissioning," this issue.
- [10] L. EL-GUEBALY, R. PAMPIN, M. ZUCCHETTI, "Insights from Clearance Assessments of Fusion Power Plants: ARIES and PPCS," University of Wisconsin Fusion Technology Institute Report, UWFD-1292 (July 2006). Available at: <http://fti.neep.wisc.edu/pdf/fdm1292.pdf>
- [11] R. PAMPIN, V. MASSAUT, N.P. TAYLOR, "Revision of the radioactive material analysis of near-term PPCS models," this issue.
- [12] F. NAJMABADI, "Exploration of Compact Stellarators as Power Plants: Initial Results from ARIES-CS Study," *Fusion Science & Technology* **47**, No. 3 (2005) 407.
- [13] D. MAISONNIER et al. (ed), "A Conceptual Study of Commercial Fusion Power Plants". Final Report of the European Fusion Power Plant Conceptual Study (PPCS), Report EFDA-RP-RE-5.0 (2005).
- [14] R.A. FORREST, N.P. TAYLOR, R. PAMPIN, "Categorization of Active Material from PPCS Model Power Plants", presented at First IAEA Technical Meeting on First Generation of Fusion Power Plant Design and Technology", 5-7 July 2005, Vienna, Austria. Available at <http://www.fusion.org.uk/techdocs/index.htm>.